

LOUISIANA FIRE SERVICE CATALOG

SEES
SOUTHERN ELEVATOR
& ELECTRIC SUPPLY



2781 West McNab Rd., Pompano Beach, FL 33069 • 800-526-0026 • www.SEESinc.com





Welcome to **SEES**[®]

www.SEESinc.com • 800.526.0026

"OUR MISSION IS TO BECOME THE BEST ELEVATOR PARTS COMPANY IN THE WORLD BY DEDICATING OUR RESOURCES, OUR TALENTS AND OUR ENERGIES, TO HELP IMPROVE THE ELEVATOR INDUSTRY."

SHOP ONLINE!

24 HOURS A DAY

7 DAYS A WEEK

365 DAYS A YEAR



@SEESinc



SEESinc.com/blogs



CONTENTS

LOUISIANA FIRE SERVICE CATALOG

- 1 State of Louisiana Uniform Elevator Key
- 2 Keys and Bezels
- 5 OEM Cylinders
- 6 Universal Key Switches / Haughton
- 7 Dover Key Switches
- 9 Otis / Westinghouse Key Switches
- 10 Innovation Key Switches
- 11 US / Monitor Control Key Switches / GAL Key Switches
- 12 Adams Key Switches
- 13 Payne / KONE Key Switches
- 14 Schindler Key Switches
- 15 Solutions / Latching Cylinder
- 16 Diagrams
- 19 Special Order Form
- 20 Uniform Key Application



GLOBAL HEADQUARTERS

2781 West McNab Rd., Pompano Beach, FL 33069



COME VISIT OUR DISTRIBUTION CENTER

1150 West McNab Rd., Fort Lauderdale, FL 33309

WE LOOK FORWARD TO BEING OF SERVICE TO YOU AND YOUR COMPANY:

SEES IS PROUD TO PROVIDE LOUISIANA WITH OUR 1ST LOUISIANA FIRE SERVICE CATALOG.

In this edition you will find the solutions you need to comply with Louisiana Regional Emergency Elevator Access and Uniform Fire Safety Standards. Included in this catalog are the keys, mounting rings, bezels, cylinders, switches, power control and emergency power as well as the key application and a new Special Order Form to make ordering easier on those hard to find parts.



**“EVERY SECOND COUNTS” WHEN RESPONDING TO
FIRE AND MEDICAL EMERGENCIES.**

The Louisiana Uniform Elevator Key Program was adopted by the Louisiana State Legislature to give emergency responders faster access to buildings to help save lives. **The Legislative Act is listed below:**

Regular Session, 2008

HOUSE BILL NO. 1159

BY REPRESENTATIVE ST. GERMAIN

AN ACT

To enact R.S. 40:1651, relative to emergency elevator access; to provide for emergency elevator access; to require one master key; to allow for substitute emergency measures; to provide for enforcement; to provide for penalties; to grant rulemaking authority; to provide for definitions; and to provide for related matters.

Be it enacted by the Legislature of Louisiana:

Section 1. R.S. 40:1651 is hereby enacted to read as follows:

§1651. Emergency elevator access; master key; substitute emergency measures; enforcement; penalty; rulemaking authority

- A. For each building in this state which is six or more stories in height, including but not limited to hotels and condominiums, which is constructed or substantially renovated after January 1, 2009, all of the keys for elevators that allow public access, including but not limited to service and freight elevators, shall be keyed so as to allow all elevators to operate in fire emergency situations with one master elevator key.
- B. Each existing building in this state which is six or more stories in height shall comply with Subsection A of this Section before January 1, 2012.
- C. In addition to elevator owners, owners' agents, elevator contractors, state certified inspectors, and state agency representatives, master elevator keys shall be issued only to the fire department in whose jurisdiction the building is located and shall not be issued to any other emergency response agency. A person shall not duplicate a master elevator key for issuance to, or issue such a key to, anyone other than the authorized fire department personnel. Each master elevator key shall be marked "DO NOT DUPLICATE".

ENROLLED

ACT No. 749

- D. If it is technically, financially, or physically impossible to bring a building into compliance with this Section, the state fire marshal may allow substitute emergency measures that will provide reasonable emergency elevator access.
- E. The office of state fire marshal shall enforce this Section. Any person who fails to comply with the requirements of this Section is subject to an administrative fine of not more than one thousand dollars, in addition to any other penalty provided by law. All administrative fines shall be deposited into the Louisiana Fire Marshal Fund.
- F. Architects and builders shall make every effort to use new technology and developments in keying systems which make it possible to convert existing equipment so as to provide efficient emergency elevator access. The office of state fire marshal shall adopt rules, pursuant to the Administrative Procedure Act, to implement the provisions of this Section.
- H. For the purposes of this Section, "substantially renovated" means an existing building which has alterations or repairs costing in excess of fifty percent of the then physical value of the building. The cost of alterations or repairs shall be established by an estimate signed by a licensed architect, by a licensed general contractor, or in the absence of either such licensed person, by the state fire marshal.



Always Smooth Sailing



BOBBY JINDAL
GOVERNOR

DEPARTMENT OF PUBLIC SAFETY AND CORRECTIONS

Public Safety Services



H. BUTCH BROWNING
STATE FIRE MARSHAL

MEMORANDUM

Date: August 6, 2009

To: Owners and Managers of Buildings Six or More Stories in Height

From: H. "Butch" Browning, Louisiana State Fire Marshal

Re: **Emergency Elevator Access
Act 749 of the 2008 Louisiana Legislative Session**

The Louisiana Legislature, during the Regular Session of 2008 passed Act 749, regarding emergency elevator access. The law requires, for each building in this state six or more stories in height constructed or substantially renovated after January 1, 2009, that all of the keys for elevators that allow public access be keyed so as to allow all elevators to operate in fire emergency situations with one master elevator key.

The law further requires that each existing building in this state which is six or more stories in height shall comply with Subsection A of this Section before January 1, 2012.

Act 749 stipulates that, if it is technically, financially, or physically impossible to bring a building into compliance, the state fire marshal may allow substitute emergency measures that will provide reasonable emergency elevator access. The Office of State Fire Marshal has promulgated rules for implementation of this law which identifies measures that will assure that each existing building subject to the law can be retrofitted to comply. A copy of the law and rule are included with this memo.

Owners of existing buildings subject to the law are asked to provide to the Office of State Fire Marshal by January 1, 2010, a timeline for implementation of the requirements of this law. Questions should be directed to Felicia Cooper by email: felicia.cooper@dps.la.gov.

We thank you for taking this step in providing a vital measure of safety for your buildings and for first responders who may need access to elevators in times of emergency.

Is Yours Working"??
Smoke Detectors Save Lives!!
OFFICE OF THE STATE FIRE MARSHAL
8181 INDEPENDENCE BOULEVARD, BATON ROUGE, LA 70806
(225) 925-4911 1-800-256-5452

HOW TO ACQUIRE THE STATE MANDATED LOUISIANA FIRE SERVICE KEYS:

- 1) To purchase the new Uniform Elevator Key (**Key Only**), fill out a Louisiana State application, *located on pg. 20*
- 2) Fax completed application and order form to **SEES (Southern Elevator & Electric Supply)** at 954-917-7337 or for help call 800.526.0026 and speak to a customer service representative.
Monday – Friday from 8:00 a.m. to 7:00 p.m. (ET)

You do not need to fill out an application or seek approval to purchase the Key Cylinders, Bezels, or any other miscellaneous parts. The **Louisiana State Application** is required for the keys.

IF YOU NEED A SPECIAL OR CUSTOM SOLUTION PLEASE FILL OUT FORM ON pg.19 or CALL SEES FOR ASSISTANCE.

LOUISIANA FIRE KEYS

ITEM #	DESCRIPTION
LA-UEK	Louisiana Fire Service , Elevator Key



**application on pg. 20*

§2905. Requirements for Master Elevator Keys

A. All elevator keys within the state as set forth in these rules shall be uniform and specific for the state of Louisiana. All elevator keys will be cut to a uniform key code, specified as "LA-UEK"

UNIVERSAL BEZELS

ITEM #	DESCRIPTION
2.25" OD X 1.15" ID	
FFB-001	Fire Service Bezel, PHI, (BYPASS-OFF-ON)
FFB-002	Fire Service Bezel, PHII, (OFF-HOLD-ON)
FFB-003	Fire Service Bezel, PHI, (RESET-OFF-ON)
FFB-004	Fire Service Bezel, PHI & PHII, (OFF-ON)

**comes with FFBR-001 adhesive ring*



IMPULSE BEZELS

ITEM #	DESCRIPTION
FFB-005H	Fire Service Impulse, PHI, Horizontal, Square (BYPASS-OFF-ON)
FFB-005HR	Fire Service Impulse, PHI, Horizontal, Round (BYPASS-OFF-ON)
FFB-005V	Fire Service Impulse, PHI, Vertical, Square (BYPASS-OFF-ON)
FFB-005VR	Fire Service Impulse, PHI, Vertical, Round (BYPASS-OFF-ON)
FFB-006H	Fire Service Impulse, PHII, Horizontal, Square (OFF-HOLD-ON)
FFB-006HR	Fire Service Impulse, PHII, Horizontal, Round (OFF-HOLD-ON)
FFB-006V	Fire Service Impulse, PHII, Vertical, Square (OFF-HOLD-ON)
FFB-006VR	Fire Service Impulse, PHII, Vertical, Round (OFF-HOLD-ON)
FFB-007H	Fire Service Impulse, PHI, Horizontal, Square (RESET-OFF-ON)
FFB-007HR	Fire Service Impulse, PHI, Horizontal, Round (RESET-OFF-ON)
FFB-007V	Fire Service Impulse, PHI, Vertical, Square (RESET-OFF-ON)
FFB-007VR	Fire Service Impulse, PHI, Vertical, Round (RESET-OFF-ON)
FFB-051H	Fire Service Impulse, Horizontal, Square (OFF-ON)
FFB-051HR	Fire Service Impulse, Horizontal, Round (OFF-ON)
FFB-052V	Fire Service Impulse, Vertical, Square (OFF-ON)
FFB-052VR	Fire Service Impulse, Vertical, Round (OFF-ON)

**square bezels come with FFBB-001 backing*
**round bezels come with bracket and spacers*

US BEZELS

ITEM #	DESCRIPTION
FFB-008	Fire Service US Bezel, PHI, 1-3/4" OD (BYPASS-OFF-ON)
FFB-009	Fire Service US Bezel, PHII, 1-3/4" OD (OFF-HOLD-ON)
FFB-010	Fire Service US Bezel, PHI, 1-3/4" OD (RESET-OFF-ON)
FFB-011	Fire Service US Bezel, PHII, 1-3/4" OD Emergency Power (OFF-1-7)
FFB-031	Fire Service US Bezel, (Power Control) 2 Position (OFF-ON)

**comes with FFBR-002 adhesive ring, backing and lock washer*

FIRE SERVICE KEY FUNCTIONS

**key is removable in this position*

PHASE I	BYPASS	OFF	ON
HALL		*	*

PHASE II	OFF	HOLD	ON
CAR	*	*	*


** Prior to the 2000 code, Special orders required for 3 key pull*

PHASE I	RESET	OFF	ON
HALL		*	*

** After 2000*

PHASE II	OFF	HOLD	ON
CAR	*	*	

** After 2000*

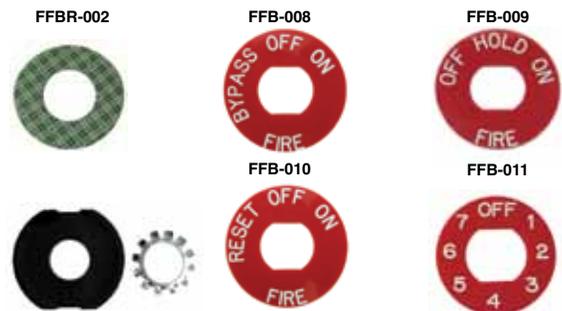

TRADITIONAL BEZELS

ITEM #	DESCRIPTION
FFB-012	Fire Service Traditional Bezel PHI Horizontal, (BYPASS-OFF-ON)
FFB-012V	Fire Service Traditional Bezel PHI Vertical, (BYPASS-OFF-ON)
FFB-013	Fire Service Traditional Bezel PHII Horizontal, (OFF-HOLD-ON)
FFB-013V	Fire Service Traditional Bezel PHII Vertical, (OFF-HOLD-ON)
FFB-014	Fire Service Traditional Bezel PHI Horizontal, (RESET-OFF-ON)
FFB-014V	Fire Service Traditional Bezel PHI Vertical, (RESET-OFF-ON)
FFB-012S	Fire Service Traditional Bezel Horizontal, (OFF-ON)
FFB-012VS	Fire Service Traditional Bezel Vertical, (OFF-ON)

*comes with universal mounting bracket



AURORA BEZELS

ITEM #	DESCRIPTION
FFB-015	Fire Service Aurora Bezel PHI, (BYPASS-OFF-ON)
FFB-016	Fire Service Aurora Bezel PHII, (OFF-HOLD-ON)
FFB-017	Fire Service Aurora Bezel PHI, (RESET-OFF-ON)
FFB-053	Fire Service Aurora Bezel, (OFF-ON)

*comes with backing and lock washer



MONITOR CONTROL BEZELS

ITEM #	DESCRIPTION
FFB-018	Fire Service Monitor Control Bezel Round PHI, (BYPASS-OFF-ON)
FFB-019	Fire Service Monitor Control Bezel Round PHII, (OFF-HOLD-ON)
FFB-020	Fire Service Monitor Control Bezel Round PHI, (RESET-OFF-ON)
FFB-054	Fire Service Monitor Control Bezel Round, (OFF-ON)



GAL BEZELS

ITEM #	DESCRIPTION
FFB-025	Fire Service GAL Bezel, Round PHI, Horizontal, (BYPASS-OFF-ON)
FFB-025V	Fire Service GAL Bezel, Round PHI, Vertical, (BYPASS-OFF-ON)
FFB-026	Fire Service GAL Bezel, Round PHII, Horizontal, (OFF-HOLD-ON)
FFB-026V	Fire Service GAL Bezel, Round PHII, Vertical, (OFF-HOLD-ON)
FFB-027	Fire Service GAL Bezel, Round PHI, Horizontal, (RESET-OFF-ON)
FFB-027V	Fire Service GAL Bezel, Round PHI, Vertical, (RESET-OFF-ON)
FFB-049	Fire Service GAL Bezel, Round, Horizontal, (OFF-ON)
FFB-049V	Fire Service GAL Bezel, Round, Vertical, (OFF-ON)


*comes with mounting bracket



INNOVATION BEZELS

ITEM #	DESCRIPTION
FFB-021	Fire Service Innovation Bezel Round PHI, (RESET-OFF-ON)
FFB-021A	Fire Service Innovation Bezel Round PHI, (BYPASS-OFF-ON)
FFB-022	Fire Service Innovation Bezel Round PHII, (OFF-HOLD-ON)
FFB-023	Fire Service Innovation Bezel Square PHI, (RESET-OFF-ON)
FFB-023A	Fire Service Innovation Bezel Square PHI, (BYPASS-OFF-ON)
FFB-024	Fire Service Innovation Bezel Square PHII, (OFF-HOLD-ON)
FFB-042	Fire Service Innovation Bezel Round, 2 Position, (OFF-ON)
FFB-042A	Fire Service Innovation Bezel Square, 2 Position, (OFF-ON)
FFB-067	Fire Service Innovation Bezel retrofit kit, (Byp-Off-On)
FFB-068	Fire Service Innovation Bezel retrofit kit, (Off-Hold-On)
FFB-069	Fire Service Innovation Bezel retrofit kit, (Reset-Off-On)
FFB-070	Fire Service Innovation Bezel retrofit kit, (Off-On)

*retro fit kit re-uses existing parts and works with LA-KS keyswitch.

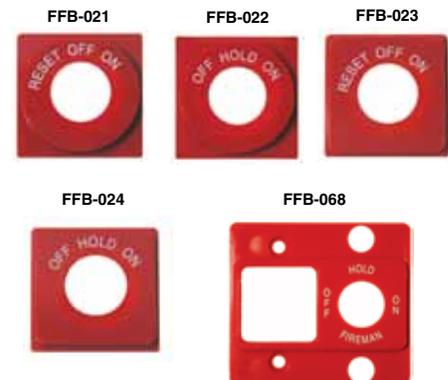

ADAMS BEZELS

ITEM #	DESCRIPTION
FFB-032	Fire Service Adams Bezel, Round PHI, (BYPASS-OFF-ON)
FFB-033	Fire Service Adams Bezel, Round PHII, (OFF-HOLD-ON)
FFB-034	Fire Service Adams Bezel, Round PHI, (RESET-OFF-ON)
FFB-056	Fire Service Adams Bezel, Round, (OFF-ON)
FFB-062	Fire Service Adams Bezel, Square PHI, (BYPASS-OFF-ON)
FFB-063	Fire Service Adams Bezel, Square PHII, (OFF-HOLD-ON)
FFB-064	Fire Service Adams Bezel, Square PHI, (RESET-OFF-ON)
FFB-065	Fire Service Adams Bezel, Square, (OFF-ON)



UNIVERSAL BEZELS

ITEM #	DESCRIPTION
1-3/8" OD	
FFB-035	Fire Service Universal Bezel, (OFF-ON)
FFB-036	Fire Service Universal Bezel, PHI, (BYPASS-OFF-ON)
FFB-037	Fire Service Universal Bezel, PHII, (OFF-HOLD-ON)
FFB-038	Fire Service Universal Bezel, PHI, (RESET-OFF-ON)



**comes with backing and lock washer*

WESTINGHOUSE BEZELS

ITEM #	DESCRIPTION
FFB-028	Fire Service Westinghouse Bezel, PHI, (BYPASS-OFF-ON)
FFB-029	Fire Service Westinghouse Bezel, PHII, (OFF-HOLD-ON)
FFB-030	Fire Service Westinghouse Bezel, PHI, (RESET-OFF-ON)
FFB-055	Fire Service Westinghouse Bezel, (OFF-ON)



PAYNE BEZELS

ITEM #	DESCRIPTION
FFB-039	Fire Service Payne Bezel, PHI, (BYPASS-OFF-ON)
FFB-040	Fire Service Payne Bezel, PHII, (OFF-HOLD-ON)
FFB-041	Fire Service Payne Bezel, PHI, (RESET-OFF-ON)
FFB-066	Fire Service Payne Bezel, (OFF-ON)



SCHINDLER CT BEZELS

ITEM #	DESCRIPTION
FFB-043	Fire Service Schindler CT Bezel, PHI, (BYPASS-OFF-ON)
FFB-044	Fire Service Schindler CT Bezel, PHII, (OFF-HOLD-ON)
FFB-045	Fire Service Schindler CT Bezel, PHI, (RESET-OFF-ON)
FFB-057	Fire Service Schindler CT Bezel, (OFF-ON)



**comes with faceplate and bezel*

SCHINDLER MTA BEZELS

ITEM #	DESCRIPTION
FFB-058	Fire Service Schindler MTA Bezel, PHI, (BYPASS-OFF-ON)
FFB-059	Fire Service Schindler MTA Bezel, PHII, (OFF-HOLD-ON)
FFB-060	Fire Service Schindler MTA Bezel, PHI, (RESET-OFF-ON)
FFB-061	Fire Service Schindler MTA Bezel, (OFF-ON)



**comes with faceplate, bezel and bracket*

KONE LEGEND BEZELS


ITEM #	DESCRIPTION
FFB-046	Fire Service Kone Legend Bezel, PHI, (BYPASS-OFF-ON)
FFB-047	Fire Service Kone Legend Bezel, PHII, (OFF-HOLD-ON)
FFB-048	Fire Service Kone Legend Bezel, PHI, (RESET-OFF-ON)
FFB-061	Fire Service Kone Legend Bezel, (OFF-ON)

**comes with bracket and hardware*




MOUNTING RINGS

ITEM #	DESCRIPTION
FFBB-001	Backing "D" Shape for Impulse series
FFBR-001	Adhesive Mounting Ring 2.25" OD x 1.125" ID
FFBR-002	Adhesive Mounting Ring 1.175"OD x .9375" ID

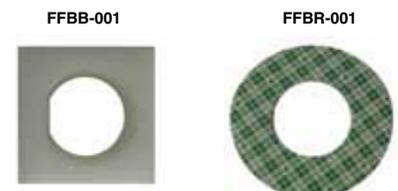

OEM CYLINDER 3/4"


ITEM #	DESCRIPTION
LA-KS1	LA Fire Service OEM Cylinder 3/4", PH 1, 3 Position, 2 Key pull
LA-KS2	LA Fire Service OEM Cylinder 3/4", PH 2, 3 Position, 2 Key pull
LA-KS3	LA Fire Service OEM Cylinder 3/4", 3 Position, 3 Key pull
LA-KS4	LA Fire Service OEM Cylinder 3/4", 2 Position, 2 Key pull

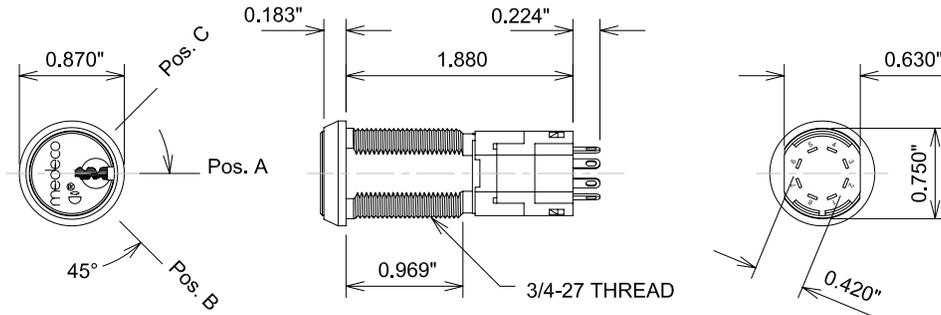

**all cylinders come pre-wired,
see wiring diagram on pg.16*


OEM CYLINDER 7/8"

ITEM #	DESCRIPTION
LA-KS1A	LA Fire Service OEM Cylinder 7/8", PH 1, 3 Position, 2 Key pull
LA-KS2A	LA Fire Service OEM Cylinder 7/8", PH 2, 3 Position, 2 Key pull

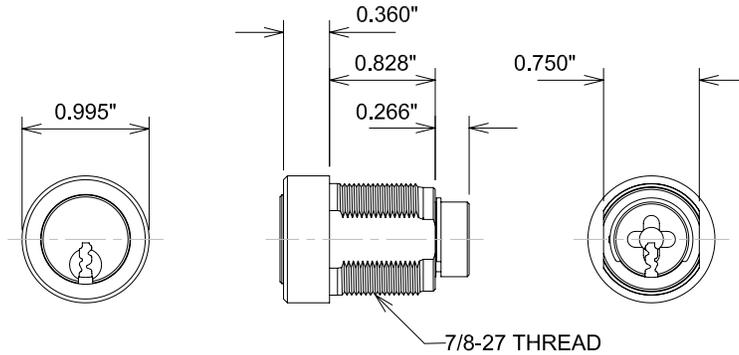


OEM KEY CYLINDER SERIES

ITEM #	DESCRIPTION
LA-CY-001	OEM Key Cylinder, Chrome Face with Bracket, PH 1, 3 Position, 2 Key pull
LA-CY-002	OEM Key Cylinder, Chrome Face with Bracket, PH 2, 3 Position, 2 Key pull

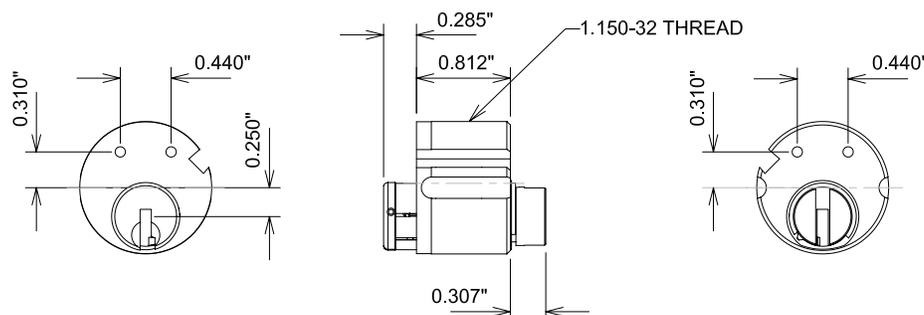

UNIVERSAL 3/4" KEY SWITCH SERIES

ITEM #	DESCRIPTION
	PHASE I
LA-UN-001	LA Fire Service , Universal PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-UN-001R	LA Fire Service , Universal PH 1, 3 Position, Removable 2, (Reset-Off-On)
	PHASE II
LA-UN-002	LA Fire Service , Universal PH 2, 3 Position, Removable 2, (Off-Hold-On)
	2 POSITION
LA-UN-003	LA Fire Service , Universal 2 Position, Removable 2, (Off-On)
LA-UN-SPECIAL	LA Fire Service Universal, 3/4", specify markings, key pull and key position, SEE ORDER FORM pg. 19

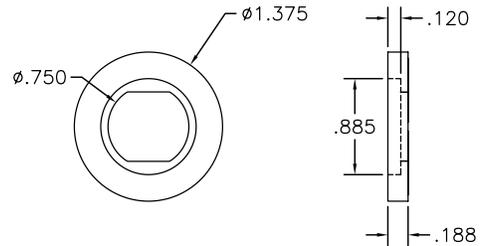


UNIVERSAL KEY SWITCH

ITEM #	DESCRIPTION
	PHASE I
LA-SW-001	Universal Key Cylinder with Bezel PH 1, 3 Position, 2 Key pull, (Bypass-Off-On)
LA-SW-001R	Universal Key Cylinder with Bezel PH 1, 3 Position, 2 Key pull, (Reset-Off-On)
	PHASE II
LA-SW-002	Universal Key Cylinder with Bezel PH 2, 3 Position, 2 Key pull, (Off-Hold-On)
	2 POSITION
LA-SW-003	Universal Key Cylinder with Bezel 2 Position, 2 Key pull, (Off-On)
LA-SW-SPECIAL	LA Fire Service Universal, specify markings, key pull and key position, SEE ORDER FORM pg. 19



LASW Type Drill Detail (1-5/32")
 *Not required but desired
 Shown @ 12

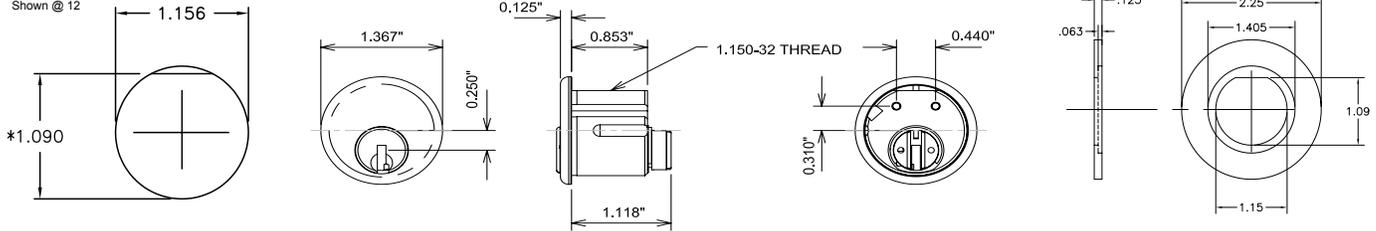

HAUGHTON KEY SWITCH SERIES


ITEM #	DESCRIPTION
	PHASE I
LA-HT-001H	LA Fire Service, Haughton, Horizontal, PH 1, 3 Position, Removable 2 (Bypass-Off-On)
LA-HT-001V	LA Fire Service, Haughton, Vertical, PH 1, 3 Position, Removable 2, (Bypass-Off-On)
	PHASE II
LA-HT-002H	LA Fire Service, Haughton, Horizontal, PH 2, 3 Position, Removable 2, (Off-Hold-On)
LA-HT-002V	LA Fire Service, Haughton, Vertical, PH 2, 3 Position, Removable 2, (Off-Hold-On)
	2 POSITION
LA-HT-003H	LA Fire Service, Haughton, Horizontal, 2 Position, Removable 2, (Off-On)
LA-HT-003V	LA Fire Service, Haughton, Vertical, 2 Position, Removable 2, (Off-On)
LA-HT-SPECIAL	LA Fire Service Haughton, specify markings, key pull and key position, SEE ORDER FORM pg. 19



DOVER TRADITIONAL KEY SWITCH SERIES

ITEM #	DESCRIPTION
	PHASE I
LA-TR-001H	LA Fire Service, Traditional, Horizontal, PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-TR-001V	LA Fire Service, Traditional, Vertical, PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-TR-001HR	LA Fire Service, Traditional, Horizontal, PH 1, 3 Position, Removable 2, Reset-Off-On
LA-TR-001VR	LA Fire Service, Traditional, Vertical, PH 1, 3 Position, Removable 2, (Reset-Off-On)
	PHASE II
LA-TR-002H	LA Fire Service, Traditional, Horizontal, PH 2, 3 Position, Removable 2, (Off-Hold-On)
LA-TR-002V	LA Fire Service, Traditional, Vertical, PH 2, 3 Position, Removable 2, (Off-Hold-On)
	2 POSITION
LA-TR-003H	LA Fire Service, Traditional, Horizontal, 2 Position, Removable 2, (Off-On)
LA-TR-003V	LA Fire Service, Traditional, Vertical, 2 Position, Removable 2, (Off-On)
LA-TR-SPECIAL	LA Fire Service Dover Traditional, specify markings, key pull and key position, SEE ORDER FORM pg.19

LA-TR-001H

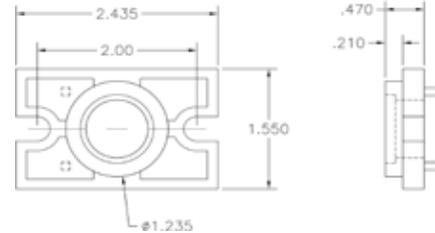

LA-TR-003H




DOVER IMPULSE SQUARE KEY SWITCH SERIES

ITEM #	DESCRIPTION
	PHASE I
LA-IMS-001H	LA Fire Service, Impulse Square, Horizontal, PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-IMS-001V	LA Fire Service, Impulse Square, Vertical, PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-IMS-001HR	LA Fire Service, Impulse Square, Horizontal, PH 1, 3 Position, Removable 2, (Reset-Off-On)
LA-IMS-001VR	LA Fire Service, Impulse Square, Vertical, PH 1, 3 Position, Removable 2, (Reset-Off-On)
	PHASE II
LA-IMS-002H	LA Fire Service, Impulse Square, Horizontal, PH 2, 3 Position, Removable 2, (Off-Hold-On)
LA-IMS-002V	LA Fire Service, Impulse Square, Vertical, PH 2, 3 Position, Removable 2, (Off-Hold-On)
	2 POSITION
LA-IMS-003H	LA Fire Service, Impulse Square, Horizontal, 2 Position, Removable 2, (Off-On)
LA-IMS-003V	LA Fire Service, Impulse Square, Vertical, 2 Position, Removable 2, (Off-On)
LA-IMS-SPECIAL	LA Fire Service Dover Impulse Square, specify markings, key pull and key position, SEE ORDER FORM pg. 19

LA-IMS-001H



LA-IMS-002V


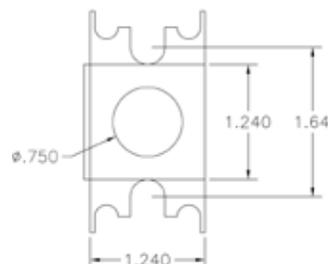


DOVER IMPULSE ROUND KEY SWITCH SERIES

ITEM #	DESCRIPTION
PHASE I	
LA-IMR-001H	LA Fire Service, Impulse Round, Horizontal, PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-IMR-001V	LA Fire Service, Impulse Round, Vertical, PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-IMR-001HR	LA Fire Service, Impulse Round, Horizontal, PH 1, 3 Position, Removable 2, (Reset-Off-On)
LA-IMR-001VR	LA Fire Service, Impulse Round, Vertical, PH 1, 3 Position, Removable 2, (Reset-Off-On)
PHASE II	
LA-IMR-002H	LA Fire Service, Impulse Round, Horizontal, PH 2, 3 Position, Removable 2, (Off-Hold-On)
LA-IMR-002V	LA Fire Service, Impulse Round, Vertical, PH 2, 3 Position, Removable 2, (Off-Hold-On)
2 POSITION	
LA-IMR-003H	LA Fire Service, Impulse Round, Horizontal, 2 Position, Removable 2, (Off-On)
LA-IMR-003V	LA Fire Service, Impulse Round, Vertical, 2 Position, Removable 2, (Off-On)
LA-IMR-SPECIAL	LA Fire Service Dover Impulse Round, specify markings, key pull and key position, SEE ORDER FORM pg. 19




FOR FEMALE STUDS
USE SPACERS PROVIDED

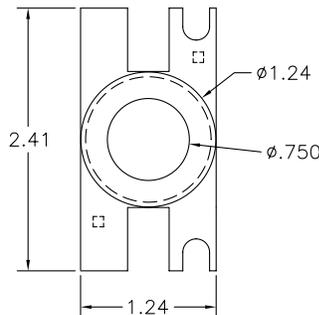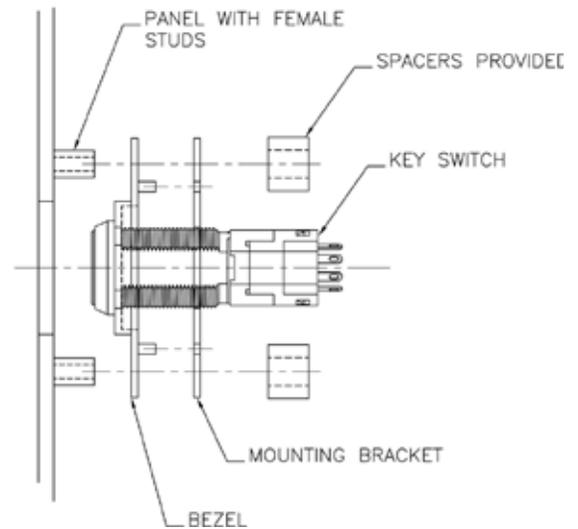

DOVER AURORA KEY SWITCH SERIES

ITEM #	DESCRIPTION
PHASE I	
LA-AU-001	LA Fire Service, Aurora PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-AU-001R	LA Fire Service, Aurora PH 1, 3 Position, Removable 2, (Reset-Off-On)
PHASE II	
LA-AU-002	LA Fire Service, Aurora PH 2, 3 Position, Removable 2, (Off-Hold-On)
2 POSITION	
LA-AU-003	LA Fire Service, Aurora 2 Position, Removable 2, (Off-On)
LA-AU-SPECIAL	LA Fire Service Dover Aurora, specify markings, key pull and key position, SEE ORDER FORM pg.19

LA-AU-002

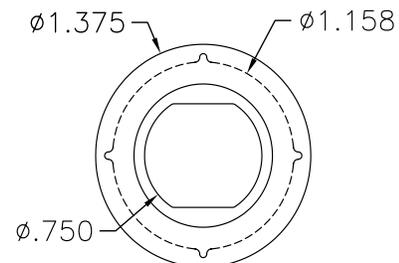


OTIS KEY SWITCH SERIES

ITEM #	DESCRIPTION
	<u>PHASE I</u>
LA-OB-001	LA Fire Service , Otis M1 PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-OB-001R	LA Fire Service , Otis M1 PH 1, 3 Position, Removable 2, (Reset-Off-On)
	<u>PHASE I</u>
LA-OB-002	LA Fire Service , Otis M1 PH 2, 3 Position, Removable 2, (Off-Hold-On)
	<u>2 POSITION</u>
LA-OB-003	LA Fire Service , Otis M1, 2 Position, Removable 2, (Off-On)
LA-OB-SPECIAL	LA Fire Service Otis, specify markings, key pull and key position, SEE ORDER FORM pg. 19



WESTINGHOUSE KEY SWITCH SERIES

ITEM #	DESCRIPTION
	<u>PHASE I</u>
LA-WB-001	LA Fire Service, Westinghouse PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-WB-001R	LA Fire Service, Westinghouse PH 1, 3 Position, Removable 2, (Reset-Off-On)
	<u>PHASE II</u>
LA-WB-002	LA Fire Service, Westinghouse PH 2, 3 Position, Removable 2, (Off-Hold-On)
	<u>2 POSITION</u>
LA-WB-003	LA Fire Service, Westinghouse, 2 Position, Removable 2, (Off-On)
LA-WB-SPECIAL	LA Fire Service Westinghouse, specify markings, key pull and key position, SEE ORDER FORM pg. 19

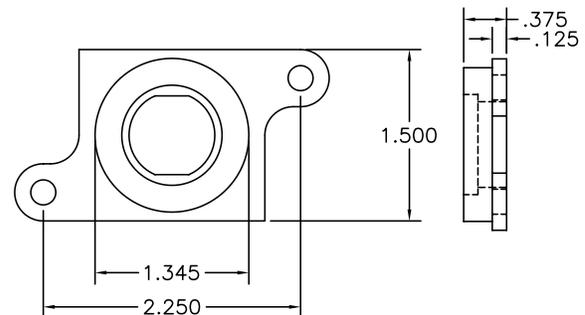

The **SEES LOUISIANA FIRE SERVICE SPECIAL ORDER FORM** is only used when ordering items not listed in this catalog.

**Please see pg.19 for more information or contact a SEES Customer Service Representative 800.526.0026.*

INNOVATION ROUND KEY SWITCH SERIES

ITEM #	DESCRIPTION
--------	-------------

* Each key switch can mount horizontal or vertical (both brackets provided)

PHASE I

LA-INR-001 LA Fire Service , Innovation Round PH 1, 3 Position, Removable 2, (Bypass-Off-On)

LA-INR-001R LA Fire Service , Innovation Round PH 1, 3 Position, Removable 2, (Reset-Off-On)

PHASE I

LA-INR-002 LA Fire Service , Innovation Round PH 2, 3 Position, Removable 2, (Off-Hold-On)


2 POSITION

LA-INR-003 LA Fire Service , Innovation Round, 2 Position, Removable 2, (Off-On)

LA-INR-SPECIAL LA Fire Service Innovation Round, specify markings, key pull and key position, SEE ORDER FORM pg.19

**Innovation key switches will fit most EPCO applications*

LA-INR-002

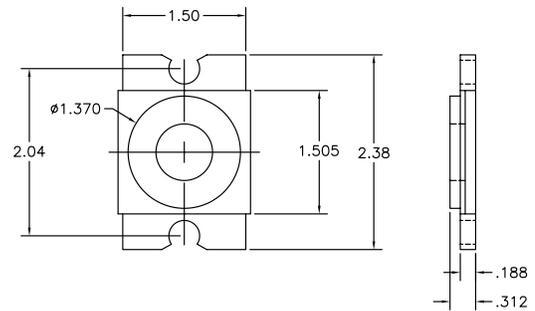

INNOVATION SQUARE KEY SWITCH SERIES

ITEM #	DESCRIPTION
--------	-------------

* Each key switch can mount horizontal or vertical (both brackets provided)

PHASE I

LA-INS-001 LA Fire Service , Innovation Square PH 1, 3 Position, Removable 2, (Bypass-Off-On)

LA-INS-001R LA Fire Service , Innovation Square PH 1, 3 Position, Removable 2, (Reset-Off-On)

PHASE II


LA-INS-002 LA Fire Service , Innovation Square PH 2, 3 Position, Removable 2, (Off-Hold-On)

2 POSITION

LA-INS-003 LA Fire Service, Innovation Square, 2 Position, Removable 2, (Off-On)

LA-INS-SPECIAL LA Fire Service Innovation Square, specify markings, key pull and key position, SEE ORDER FORM pg.19

LA-INS-001R

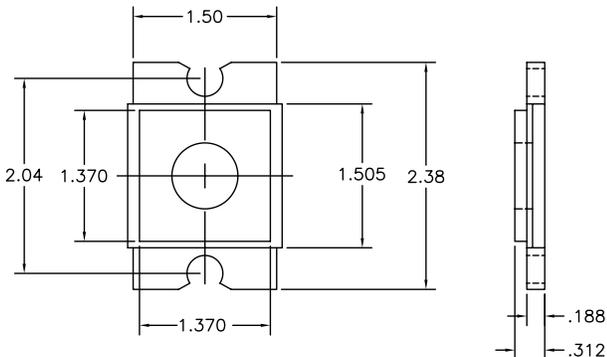


US KEY SWITCH SERIES

ITEM #	DESCRIPTION
--------	-------------

**Use LA-US-003 for 2 Position, 2 Key Pull*


LA-US-001	LA Fire Service, US PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-US-001R	LA Fire Service, US PH 1, 3 Position, Removable 2, (Reset-Off-On)
PHASE II	
LA-US-002	LA Fire Service, US PH 2, 3 Position, Removable 2, (Off-Hold-On)
2 POSITION	
LA-US-003	LA Fire Service, US, 2 Position, Removable 2, (Off-On)
LA-US-SPECIAL	LA Fire Service US, specify markings, key pull and key position, SEE ORDER FORM pg. 19

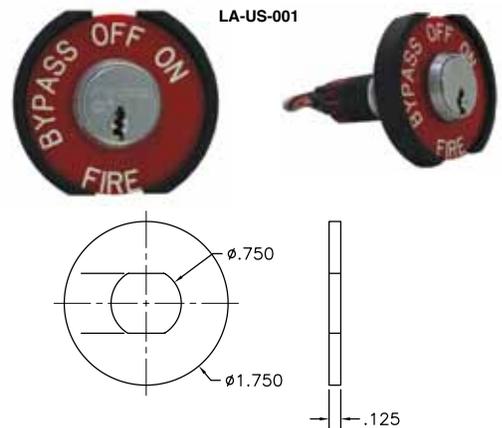

MONITOR CONTROL KEY SWITCH SERIES

ITEM #	DESCRIPTION
--------	-------------


PHASE I	
LA-MC-001	LA Fire Service, Monitor Control PH 1, 3 Position, 2 Key pull, (Bypass-Off-On)
LA-MC-001R	LA Fire Service, Monitor Control PH 1, 3 Position, 2 Key pull, (Reset-Off-On)
PHASE II	
LA-MC-002	LA Fire Service, Monitor Control PH 2, 3 Position, 2 Key pull, (Off-Hold-On)
2 POSITION	
LA-MC-003	LA Fire Service, Monitor Control, 2 Position, 2 Key pull, (Off-On)
LA-MC-SPECIAL	LA Fire Service Monitor Control, specify markings, key pull and key position, SEE ORDER FORM pg. 19

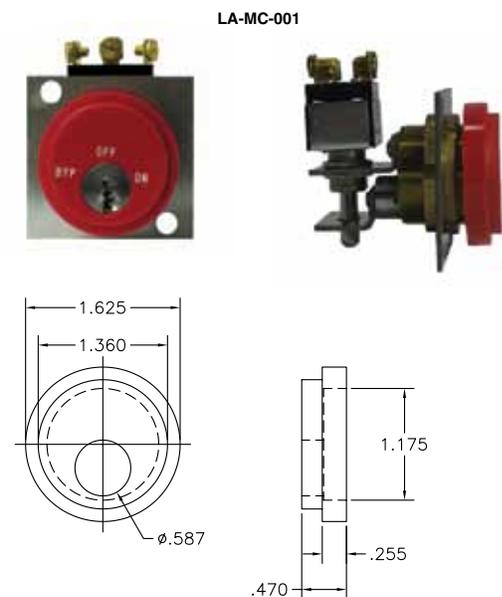

GAL KEY SWITCH SERIES


ITEM #	DESCRIPTION
--------	-------------

PHASE I	
LA-GK-001H	LA Fire Service, GAL, Round, Horizontal PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-GK-001V	LA Fire Service, GAL, Round, Vertical PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-GK-001HR	LA Fire Service, GAL, Round, Horizontal PH 1, 3 Position, Removable 2, (Reset-Off-On)
LA-GK-001VR	LA Fire Service, GAL, Round, Vertical PH 1, 3 Position, Removable 2, (Reset-Off-On)
PHASE II	
LA-GK-002H	LA Fire Service, GAL, Round, Horizontal PH 2, 3 Position, Removable 2, (Off-Hold-On)
LA-GK-002V	LA Fire Service, GAL, Round, Vertical PH 2, 3 Position, Removable 2, (Off-Hold-On)
2 POSITION	
LA-GK-003H	LA Fire Service, GAL, Round, Horizontal, 2 Position, Removable 2, (Off-On)
LA-GK-003V	LA Fire Service, GAL, Round, Vertical, 2 Position, Removable 2, (Off-On)
LA-GK-SPECIAL	LA Fire Service GAL, specify markings, key pull and key position, SEE ORDER FORM pg. 19

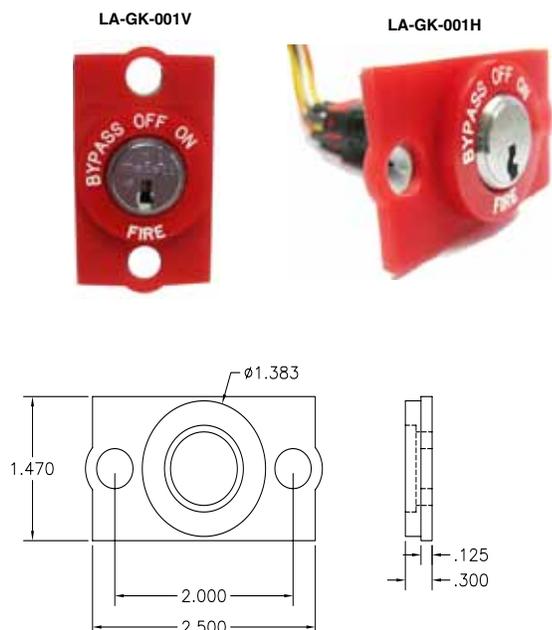


ADAMS SURVIVOR ROUND KEY SWITCH SERIES

ITEM #	DESCRIPTION
	<u>PHASE I</u>
LA-AD-001	LA Fire Service , Adams Round PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-AD-001R	LA Fire Service , Adams Round PH 1, 3 Position, Removable 2, (Reset-Off-On)
	<u>PHASE II</u>
LA-AD-002	LA Fire Service , Adams Round PH 2, 3 Position, Removable 2, (Off-Hold-On)
	<u>2 POSITION</u>
LA-AD-003	LA Fire Service , Adams Round, 2 Position, Removable 2, (Off-On)
LA-AD-SPECIAL	LA Fire Service Adams Survivor Round, specify markings, key pull and key position, SEE ORDER FORM pg.19

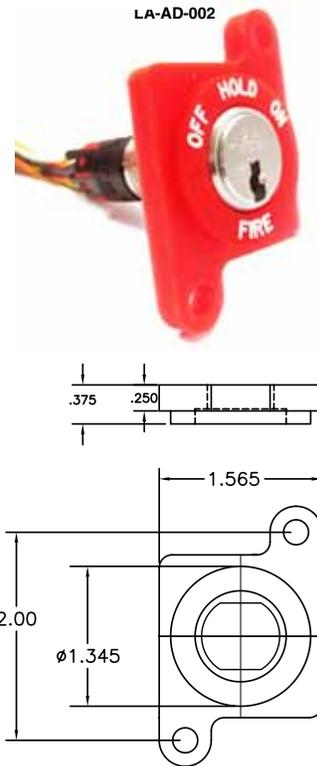


ADAMS SURVIVOR SQUARE KEY SWITCH SERIES

ITEM #	DESCRIPTION
	<u>PHASE I</u>
LA-ADS-001	LA Fire Service , Adams Square PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-ADS-001R	LA Fire Service , Adams Square PH 1, 3 Position, Removable 2, (Reset-Off-On)
	<u>PHASE II</u>
LA-ADS-002	LA Fire Service , Adams Square PH 2, 3 Position, Removable 2, (Off-Hold-On)
	<u>2 POSITION</u>
LA-ADS-003	LA Fire Service , Adams Square, 2 Position, Removable 2, (Off-On)
LA-ADS-SPECIAL	LA Fire Service Adams Survivor Square, specify markings, key pull and key position, SEE ORDER FORM pg.19

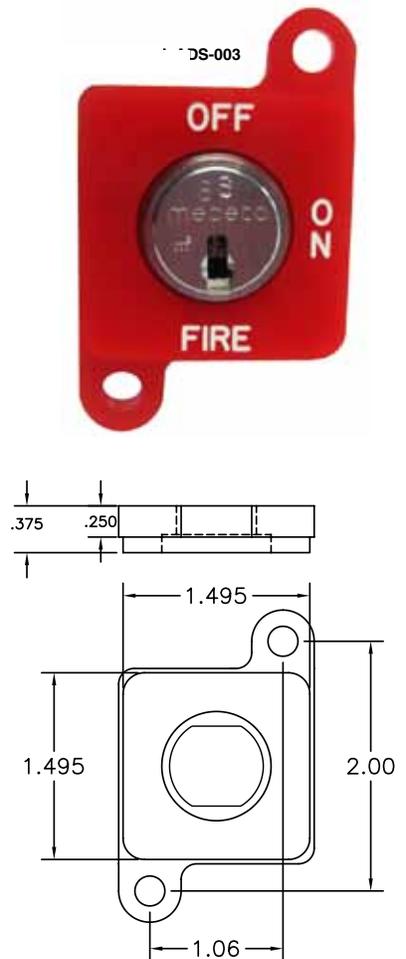


PAYNE KEY SWITCH SERIES

ITEM #	DESCRIPTION
PHASE I	
LA-PN-001	LA Fire Service , Payne PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-PN-001R	LA Fire Service , Payne PH 1, 3 Position, Removable 2, (Reset-Off-On)
PHASE II	
LA-PN-002	LA Fire Service , Payne PH 2, 3 Position, Removable 2, (Off-Hold-On)
2 POSITION	
LA-PN-003	LA Fire Service , Payne, 2 Position, Removable 2, (Off-On)
LA-PN-SPECIAL	LA Fire Service Payne, specify markings, key pull and key position, SEE ORDER FORM pg. 19

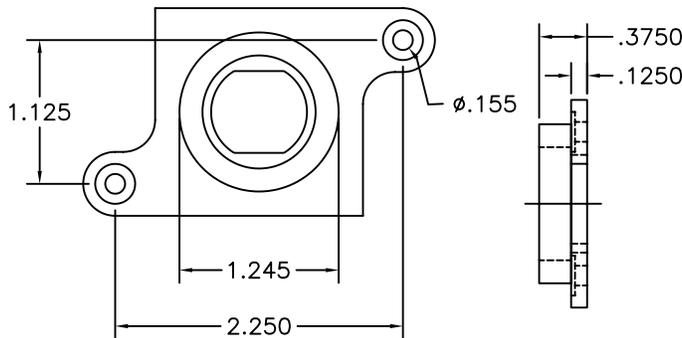

KONE LEGEND KEY SWITCH SERIES


ITEM #	DESCRIPTION
PHASE I	
LA-KN-001	LA Fire Service , Kone PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-KN-001R	LA Fire Service , Kone PH 1, 3 Position, Removable 2, (Reset-Off-On)
PHASE II	
LA-KN-002	LA Fire Service , Kone PH 2, 3 Position, Removable 2, (Off-Hold-On)
2 POSITION	
LA-KN-003	LA Fire Service , Kone, 2 Position, Removable 2, (Off-On)
LA-KN-SPECIAL	LA Fire Service Kone Legend, specify markings, key pull and key position, SEE ORDER FORM pg.19

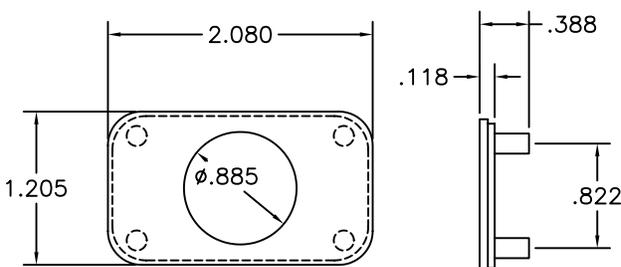

SCHINDLER CT KEY SWITCH SERIES

ITEM #	DESCRIPTION
	<u>PHASE I</u>
LA-SCH-001	LA Fire Service , Schindler CT PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-SCH-001R	LA Fire Service , Schindler CT PH 1, 3 Position, Removable 2, (Reset-Off-On)
	<u>PHASE II</u>
LA-SCH-002	LA Fire Service , Schindler CT PH 2, 3 Position, Removable 2, (Off-Hold-On)
	<u>2 POSITION</u>
LA-SCH-003	LA Fire Service , Schindler CT, 2 Position, Removable 2, (Off-On)
LA-SCH-SPECIAL	LA Fire Service Schindler CT, specify markings, key pull and key position, SEE ORDER FORM pg.19



LA-SCH-001

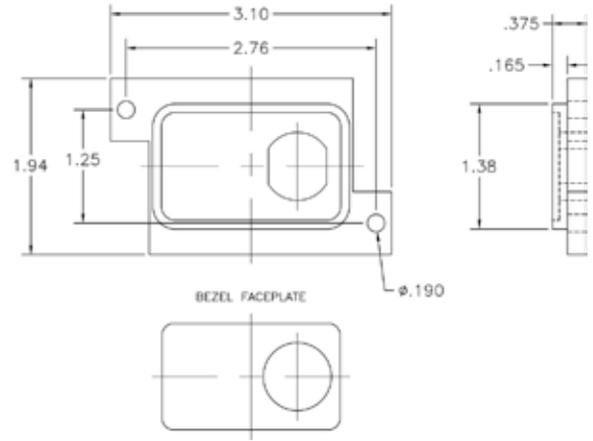

SCHINDLER MTA KEY SWITCH SERIES

ITEM #	DESCRIPTION
	<u>PHASE I</u>
LA-SCK-001	LA Fire Service , Schindler MT PH 1, 3 Position, Removable 2, (Bypass-Off-On)
LA-SCK-001R	LA Fire Service , Schindler MT PH 1, 3 Position, Removable 2, (Reset-Off-On)
	<u>PHASE II</u>
LA-SCK-002	LA Fire Service , Schindler MT PH 2, 3 Position, Removable 2, (Off-Hold-On)
	<u>2 POSITION</u>
LA-SCK-003	LA Fire Service , Schindler MT, 2 Position, Removable 2, (Off-On)
LA-SCK-SPECIAL	LA Fire Service Schindler MTA, specify markings, key pull and key position, SEE ORDER FORM pg.19


LA-SCK-002

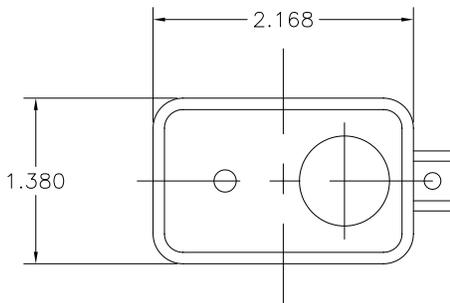

SOLUTIONS

Use the LA-KS series 3/4" Cylinder to retrofit the fixtures below.
EXAMPLES WITH PHOTOS SHOWN BELOW:

KONE VECTOR


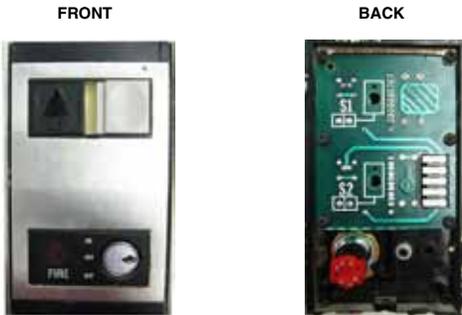


OTIS M3




MISCELLANEOUS

ITEM #	DESCRIPTION
FLSW-BRACKET	Bracket for LA Fire Service PHI & PHII Key Cylinders
FLSW-SWITCH	Rotary switch for LA Fire Service Key PHI & PHII 45 deg 1P3T
FLSW-SWITCH-D	Rotary switch for LA Fire Service Key PHI & PHII 45 deg 2P3T
FFDK-001	LA Fire Service Drill Kit Key Cylinder Stainless Steel Hole Saw
LA-EP-001	LA Fire Service Emergency Power Key Switch 8 Position, 8 Key Pull

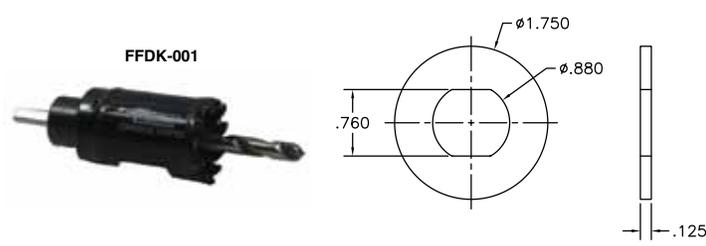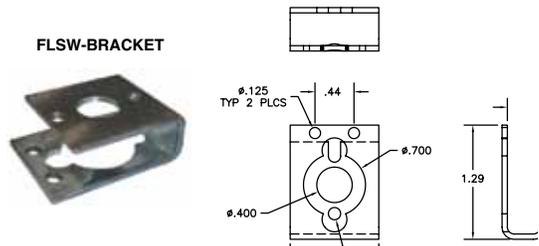


LATCHING CYLINDER FOR CABINET

ITEM #	DESCRIPTION
LA-SC-001	Louisiana Fire Service Latching Cylinder for Cabinet

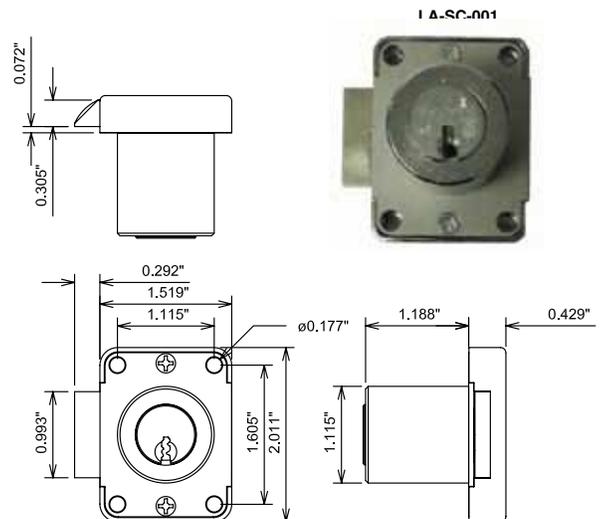


CONFIGURATION DIAGRAMS


LA-EP-001

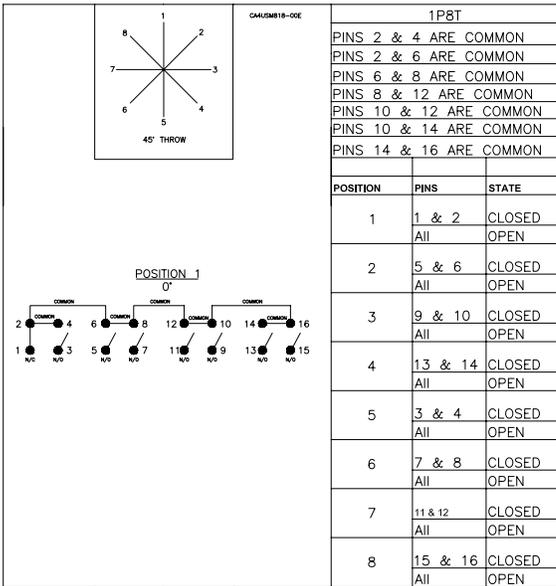

FLSW-SWITCH-D

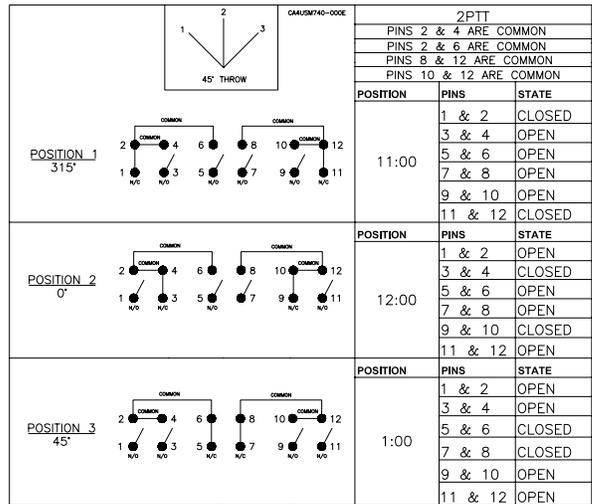

FLSW-SWITCH

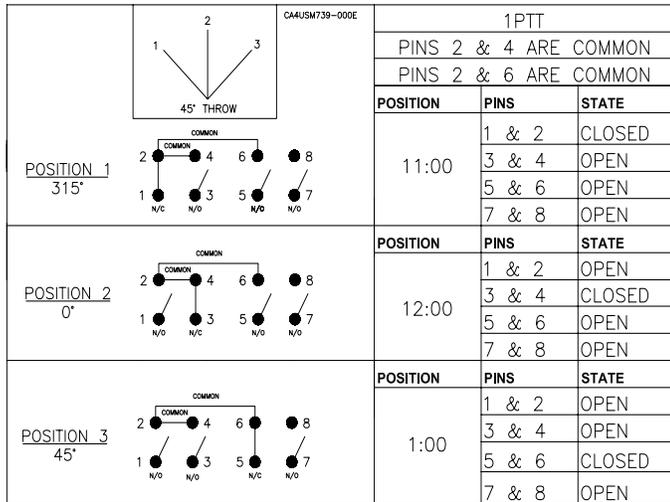

LA-EP-001



FLSW-SWITCH-D




FLSW-SWITCH




WIRING CONFIGURATION (For LA-KS Series)

Part Number	Key Positions	Key Removal	Terminals Connected		
			A	B	C
LA-KS1	A, B, C	A, B	1-8, 4-5	1-2, 5-6	3-4, 7-8
LA-KS2	A, B, C	A, C	1-8, 4-5	1-2, 5-6	3-4, 7-8
LA-KS3	A, B, C	A, B, C	1-8, 4-5	1-2, 5-6	3-4, 7-8
LA-KS4	A, B	A, B	1-8, 4-5	1-2, 5-6	-



WIRING CONFIGURATION

PIN #	COLOR	PIN #	COLOR
1	Black	5	Red
2	White	6	Brown
3	Yellow	7	Yellow with Black Stripe
4	Orange	8	Orange with Black Stripe





CALL FOR MORE INFORMATION 1-800-526-0026 | www.SEESinc.com



PLUG CLOSE UP

SEES-SCREEN-001



SEES-SCREEN-003D

*INCLUDES MOUNTING HARDWARE AND BRACKETS

The Enforcer

Door Gibs. Redefined.

SAFETY FIRST... BUILT TO LAST

- SAFETY:** Limits liability due to door failure
- DURABILITY:** Less call backs, reduce door damage
- SAVINGS:** Reduce service calls with fewer gib replacement/door alignment.

PATENT PENDING

CAN HANDLE OVER 18,000 lb OF FORCE!



SEES-ENFORCER-001
7/16"



SEES-ENFORCER-002
15/32"



SEES-ENFORCER-003
1/2"



SEES-ENFORCER-004
17/32"



SOUTHERN ELEVATOR & ELECTRIC SUPPLY

THE SEES

RESTRICTOR

FAST - EASY INSTALLATION

PROVIDES LOWEST COST SOLUTION - FITS ALL DOOR SYSTEMS



OUR JOB IS TO KEEP YOU SAFE

"THE REQUIREMENTS FOR DOOR RESTRICTORS WAS IMPLEMENTED TO PREVENT PASSENGERS FROM FALLING INTO AN OPEN HOISTWAY UNDERNEATH THE ELEVATOR PLATFORM WHILE TRYING TO EVACUATE FROM AN ELEVATOR THAT IS STUCK BETWEEN FLOORS." ~AMERICAN SOCIETY OF MECHANICAL ENGINEERS



PART# SEES-RESTRICTOR-003
(FLAG SMALL ADJUSTABLE 1.25"-2")



PART# SEES-RESTRICTOR-004
(FLAG LARGE ADJUSTABLE 2"-2.875")



PART# SEES-RESTRICTOR-006
(FLAG FIXED 1")



PART# SEES-RESTRICTOR-007
(FLAG FIXED 3")



2781 West McNab Rd., Pompano Beach, FL 33069 | 800-526-0026 | www.SEESSinc.com




DAMAGE CONTROL

NEW & IMPROVED PIT FLOOD ALARM

PART# SEES-H2O-ALARM-001 (110 VAC 4" ALARM BELL WITH "SINGLE BARREL" FLOAT SWITCH GUARD)

PART# SEES-H2O-ALARM-002 (110 VAC 4" ALARM BELL WITH AUXILIARY OUTPUT CONTACT & "DOUBLE BARREL" FLOAT SWITCH GUARDS)

THE SEES H2O ALARM FEATURES STEEL FLOAT SWITCH GUARDS TO PREVENT DAMAGE DURING INSTALLATION OR SERVICE.



"DOUBLE BARREL"
FLOAT SWITCH GUARDS



Your Elevator "Life Raft"



Fax completed form and application to **SEES** (Southern Elevator & Electric Supply) at 954-917-7337 or call to speak to a customer service representative.

Monday – Friday from 8:00 a.m. to 7:00 p.m. (ET)

You do not need to fill out an application or seek approval to purchase the Key Cylinders, Bezels, or any other miscellaneous parts. The Louisiana State Application is required for the keys.

DATE: _____ JOB#: _____ PO#: _____
 ACCOUNT#: _____ NAME: _____ PHONE: () _____ EMAIL: _____
 REQ. SHIP DATE: _____ ADDRESS: _____ CITY/ STATE: _____ ZIP: _____

PART NUMBER	KEY POSITION	KEY PULL POSITION	ORIENTATION	BEZEL COLOR
<input type="checkbox"/> LA-AU SERIES <input type="checkbox"/> LA-TR SERIES <input type="checkbox"/> LA-IMS SERIES <input type="checkbox"/> LA-IMR SERIES <input type="checkbox"/> LA-OB SERIES <input type="checkbox"/> LA-US SERIES <input type="checkbox"/> LA-WB SERIES <input type="checkbox"/> LA-INR SERIES <input type="checkbox"/> LA-INS SERIES <input type="checkbox"/> LA-MC SERIES <input type="checkbox"/> LA-GK SERIES <input type="checkbox"/> LA-EP SERIES <input type="checkbox"/> LA-AD SERIES <input type="checkbox"/> LA-ADS SERIES <input type="checkbox"/> LA-KN SERIES <input type="checkbox"/> LA-PN SERIES <input type="checkbox"/> LA-SCH SERIES <input type="checkbox"/> LA-SCK SERIES <input type="checkbox"/> LA-UN SERIES	<input type="checkbox"/> 2 POS <input type="checkbox"/> 3 POS <input type="checkbox"/> 8 POS	<input type="checkbox"/> A <input type="checkbox"/> B <input type="checkbox"/> C	<input type="checkbox"/> HORIZONTAL <input type="checkbox"/> VERTICAL	<input type="checkbox"/> RED <input type="checkbox"/> BLACK
			ROUND OR SQUARE	DIAMETER OF THRU HOLE IN PANEL
			<input type="checkbox"/> ROUND <input type="checkbox"/> SQUARE	_____ (in)
			POSITIONS	ENGRAVINGS
			12 O CLOCK	
			2-3 O CLOCK	
			6 O CLOCK	
			9-10 O CLOCK	
			FILL WITH RED or WHITE	<input type="checkbox"/> RED ENGRAVING <input type="checkbox"/> WHITE ENGRAVING
	NUMBER OF PIECES _____		12 9 3 6	
KEY PULL POSITIONS 		STUD MOUNTING DIMENSION AND ORIENTATION 		

SPECIAL ORDERS REQUIRE 1-2 WEEKS TO MANUFACTURE	
SHIPPING SERVICE REQUESTED <input type="checkbox"/> FREIGHT COLLECT UPS <input type="checkbox"/> FREIGHT COLLECT FedEX <input type="checkbox"/> VIA UPS # _____ <input type="checkbox"/> VIA FedEX # _____	<input type="checkbox"/> NDA RED 8:30AM <input type="checkbox"/> NEXT DAY ANYTIME <input type="checkbox"/> 2 DAY <input type="checkbox"/> 3 DAY GROUND
NOTES: _____ _____	

Dear Customer,
 We ask that you agree to our policy regarding non-cancelable and non-returnable products in order to eliminate any misunderstanding. The product listed above falls under this policy and once S.E.E.S. places its order with the manufacturer, this agreement will be binding. The product is non-cancelable and non-returnable regardless of any changes in your requirements. Any allocated quantity which is on our shelves or on order with the factory will be your responsibility. We will make every effort to accommodate changes in your delivery requirements however, once production has begun we may be unable to change delivery dates. All freight charges from the factory will be prepaid and applied to your invoice. S.E.E.S. reserves the right to under or over ship quantities up to 10% on non-cancelable and non-returnable products based on quantities received from the manufacturer.

Please sign and return acknowledging your understanding and agreement to the terms above.

SIGNATURE: _____

MASTER ELEVATOR KEY ORDER FORM

Louisiana Office of State Fire Marshal



PART I [Please print or type]

APPLICANT NAME: _____

ADDRESS: _____

CITY _____ STATE _____ ZIP _____

PHONE _____ - _____ - _____ FAX _____ - _____ - _____

EMAIL _____

MAILING ADDRESS (If different from above)

ADDRESS: _____

CITY _____ STATE _____ ZIP _____

PART II

I am eligible under Louisiana Rules to possess a Master Elevator Key based on the following qualification(s) [please check the appropriate box(es)]:

- (A) Local fire department personnel: certified as a firefighter and active employment or affiliation with a fire department. Please provide department information below. Form must be signed by the department Fire Chief.
- (B) Elevator owner: ownership in a building required to comply with this rule chapter
- (C) Elevator owner's agent: employment with an owner required to comply with this rule chapter
- (D) Elevator contractor: active license with the Louisiana Division of Elevators. Please provide company information and Contractor License Number below.
- (E) State-certified inspector: actively licensed as an elevator inspector by the Louisiana Division of Elevators
- (F) State agency representative: employed by a state agency in a capacity requiring access to elevator for maintenance purposes. Agency name a State Department Head signature must be provided below.

NOTE: If box (B) or (C) are checked, please provide a building address below.

Building Address: _____

PART III (Please provide the appropriate information, signatures, and approvals in the space provided below)

I hereby submit this application for the purpose of obtaining Master Elevator Keys in accordance with the Louisiana State Fire Marshal's Rule.

I further agree and certify that:

1. I will not duplicate the elevator key issued pursuant to this application;
2. Should I become ineligible to possess a Master Elevator Key in accordance with this application, I will surrender all keys in my possession to the authorized vendor that issued such key(s) or local fire department.

Applicant Signature: _____ Date: ____/____/____

Company / Organization Name _____
or Fire Department

Fire Chief or State _____ Date: ____/____/____
Department Head signature

Contractor License Number _____

Key Order Quantity: _____

Note: Please submit a Master Elevator Key Order Form with each key order

ISO 9001:2010



2781 West McNab Rd., Pompano Beach, FL 33069 • 800-526-0026 • www.SEESinc.com

Always Smooth Sailing

