REV	DESCRIPTION	APPROVED	DATE
00	PRELIMINARY	RR	08/19/24
01	UPDATED GROUND DETAILS	RR	08/20/24

*WARNING-MORE THAN ONE LIVE CIRCUIT, SEE DIAGRAM.
PARTS OF THIS CONTROLLER ARE NOT DE-ENERGIZED
BY THE DISCONNECT SWITCH

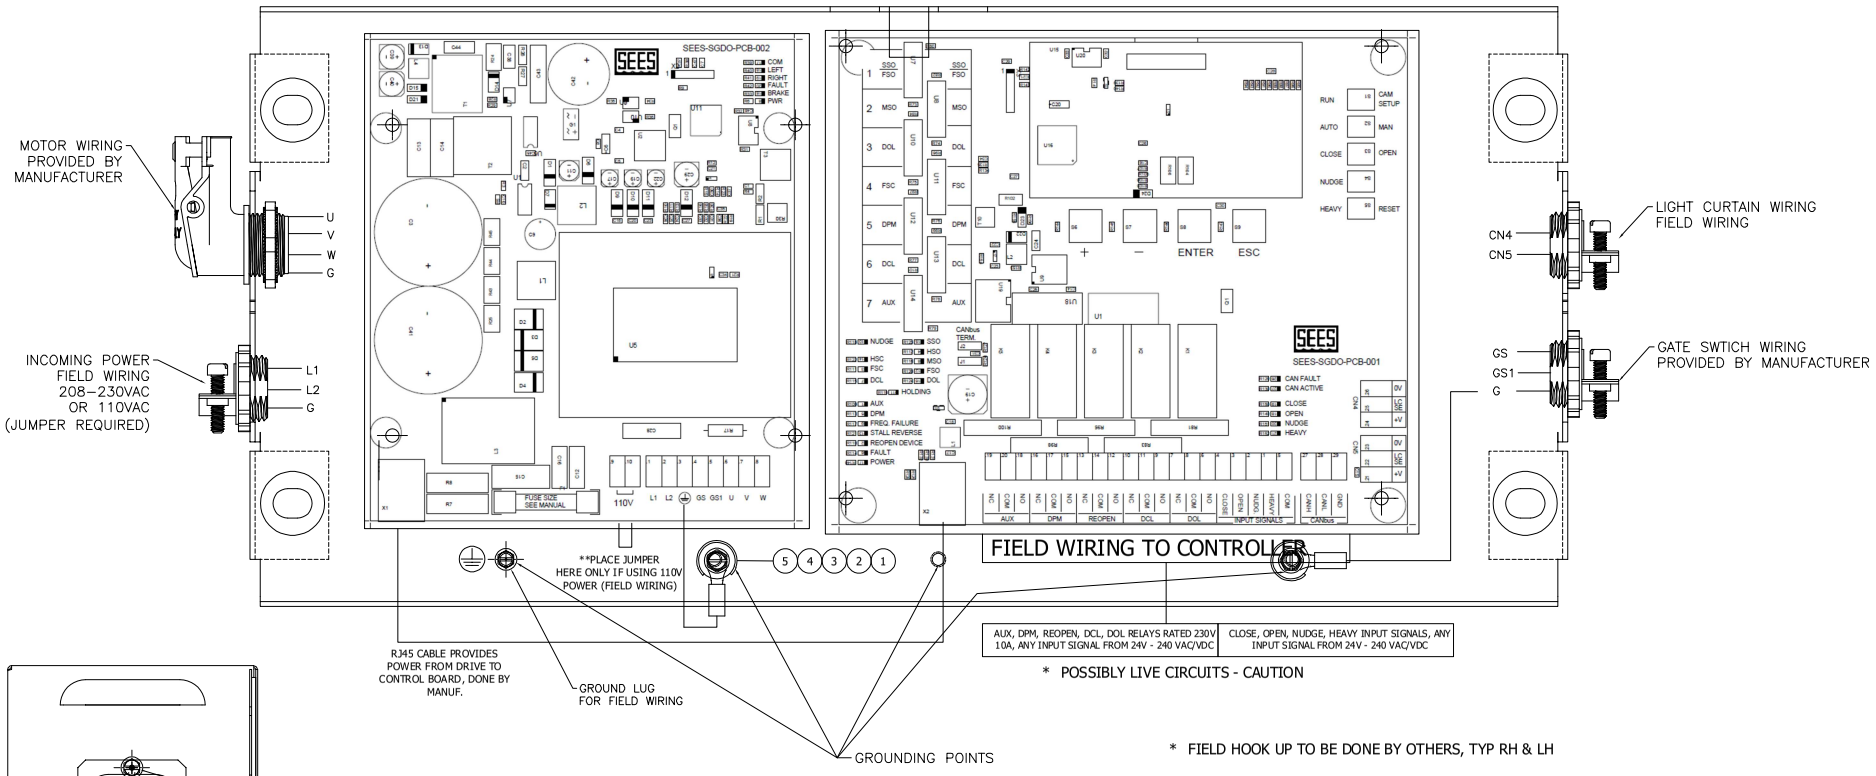

* POSSIBLY LIVE CIRCUITS - CAUTION



* FIELD HOOK UP TO BE DONE BY OTHERS, TYP RH & LH

Field Wiring
Field wiring requires certified conduit, junction box and/ or trough for running wires to Hoistway cable. Supplied by installer. Should only be performed by trained or certified personnel.

ITEM	QTY	PART NUMBER	DESCRIPTION
5		XWIR-044 AND XWIR-037	16 GA 105° 1015 BLACK WIRE
4		XHDW-850	10-32 HEX WASHER HEAD GROUND SCREW
3		3M-14 - OR EQUIV	#10 RING TERMINAL 16-14 AWG
2		XHDW-030	BRASS FLAT WASHER #8-S SMALL
1		XHDW-692	TERMINAL WASHER BRASS D3019

PARTS LIST

MATERIAL: SEE PARTS LIST

QTY. REQ'D	ITEM NO	PART OR IDENTIFYING NUMBER	DESCRIPTION
			DOOR OPERATOR

ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE SPECIFIED
.X = ±.030
.XX = ±.010
.XXX = ±.005
ANGLES = ±1°
DO NOT SCALE DRAWING

MATERIAL BOM

FINISH NATURAL

APPROVED		DATE
DRAWN BY	RR	08/19/24
PROD.	RR	08/19/24
ENG.	RR	08/19/24
QA.		
MGMT.		

THIRD ANGLE PROJECTION

SOUTHERN ELEVATOR & ELECTRIC SUPPLY
2781 W. MCNAB RD.
POMPANO BCH., FL. 33069
WWW.SEESINC.COM

SEES–SDO–001 SERIES
SEES DOOR OPERATOR

SIZE	FILE	DWG NO	REV
B	SEES–SDO–001–DR	SEES–SDO–001–DR	01

SCALE NONE SHEET 1 OF 1

ALL DESIGNS AND INFORMATION CONTAINED IN THIS DRAWING ARE PROTECTED BY COPYRIGHT AND REMAIN OUR SOLE PROPERTY AND MUST NEITHER BE REPRODUCED NOR COPIED NOR PASSED ONTO THIRD PARTIES WITHOUT OUR SPECIFIC CONSENT. SOUTHERN ELEVATOR & ELECTRIC SUPPLY.